Technical Specification

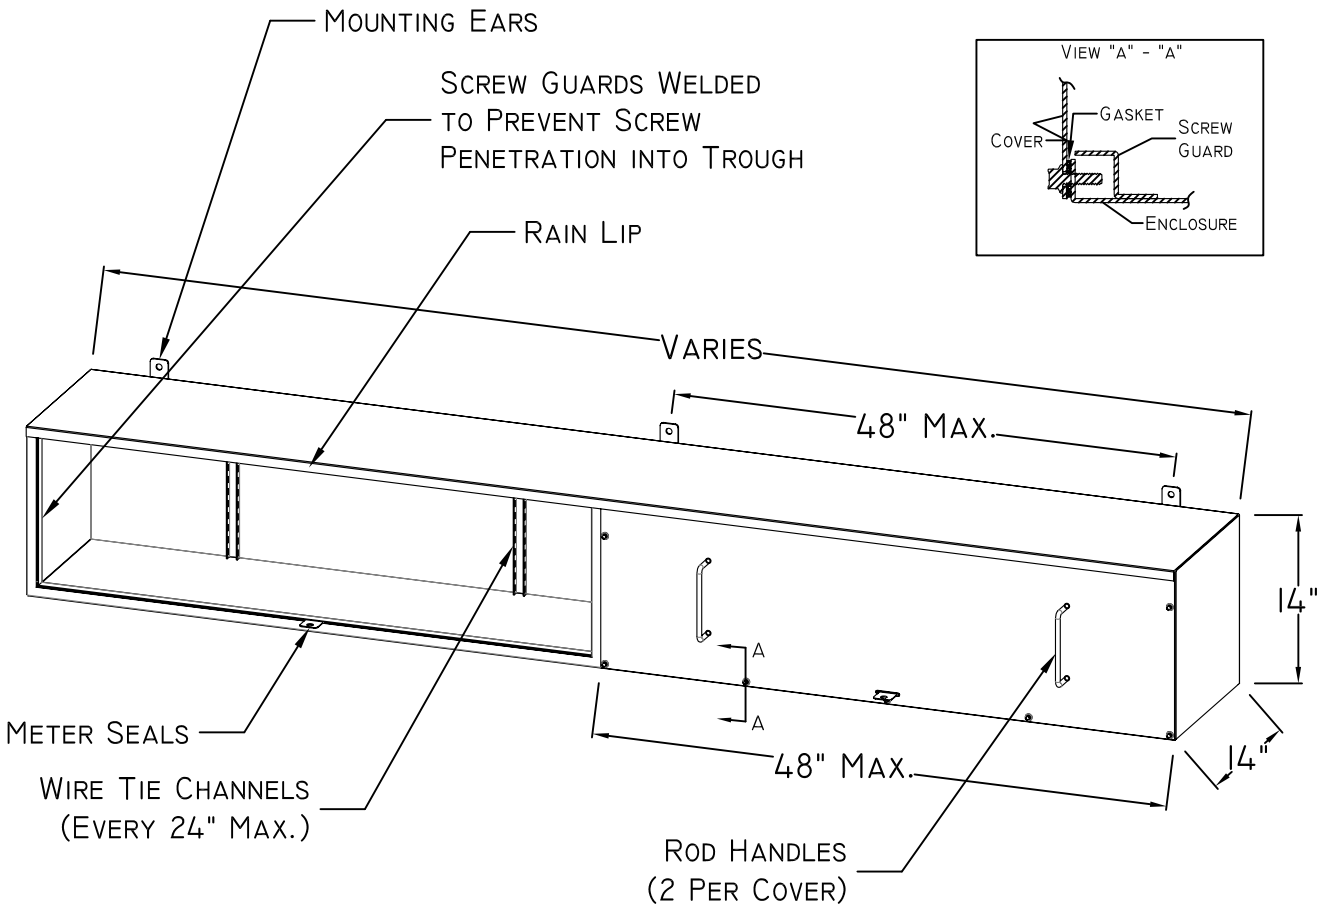

NEMA 3R BGE Service Entrance Trough

- BGE Service entrance troughs are constructed with all welded seams. Material is 14 gauge galvanized sheet steel conforming with ASTM A-924 and G90.
- Troughs are provided with mounting ears and gasketed screw covers with locking tabs and rod handles. Screw guards are welded to interior to prevent screws from penetrating into the trough. Wire tie channel welded to interior for cable training and support.
- BGE Service entrance troughs are constructed in accordance with UL bulletin #50, NEMA 3R specifications, and BGE requirements.

DWG. TITLE:	NEMA 3R BGE Service Trough Part# BGEST1414
DWG. NO.:	P10119
MATERIAL:	ASTM A924 Galvanized
FINISH:	Galvanized - None

NOTICE:
THIS INFORMATION IS THE PROPERTY OF N.J. SULLIVAN CO., ANY REPRODUCTION, PUBLICATION OR DISTRIBUTION TO A THIRD PARTY IS STRICKLY FORBIDDEN UNLESS WRITTEN PERMISSIONS ARE GIVEN BY AN AUTHORIZED AGENT OF:
N.J. SULLIVAN CO., INC.

DFTG.:	CD	DATE:	10/8/12
CHKR.:		DATE:	
REV.:		DATE:	
REV.:		DATE:	
REV.:		DATE:	

N.J. SULLIVAN Co.
INCORPORATED
P.O. BOX 438, STERLING, VIRGINIA 20167
METAL FABRICATION
Phone: (703)-464-5944 Fax: (703)-464-5992
www.njsullivan.com